


**Industrial Boilers (100 - 250 mmBtu), Gas Fired
BACT Determinations for NOx**



**Industrial Boilers (100 mmBtu - 250 mmBtu), Gas Fired
Average Annual NOx BACT Determinations**

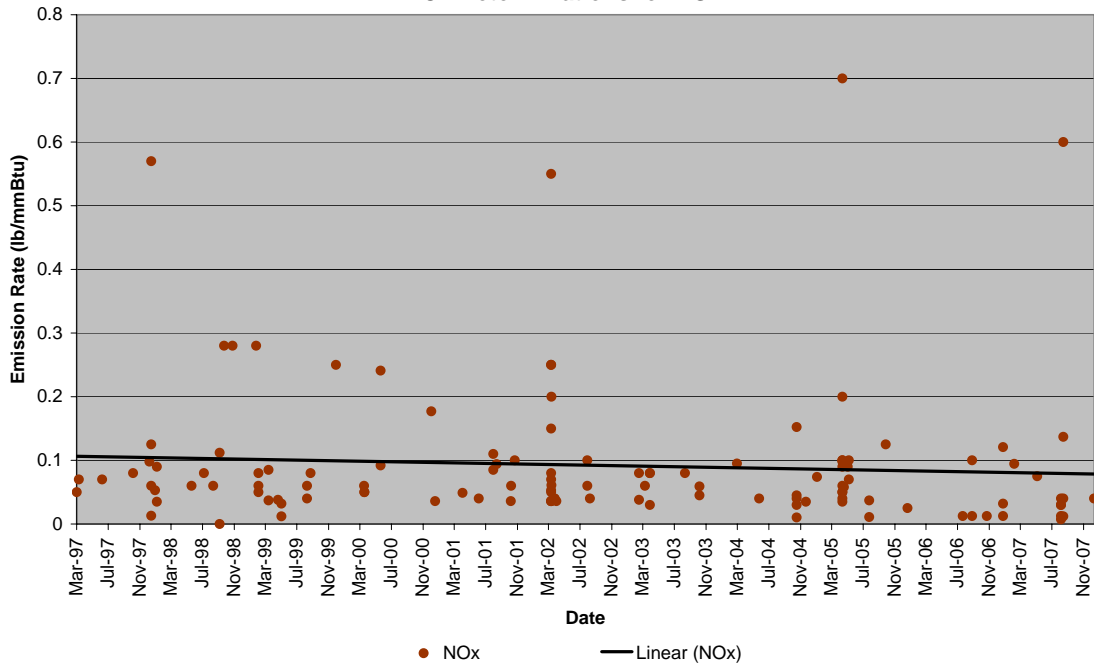